




# SEAL REPORT

Envelope sealing performed for:

Date:  
Floor Area: 42.00 m<sup>2</sup>  
Structure Volume: 113.40 m<sup>3</sup>

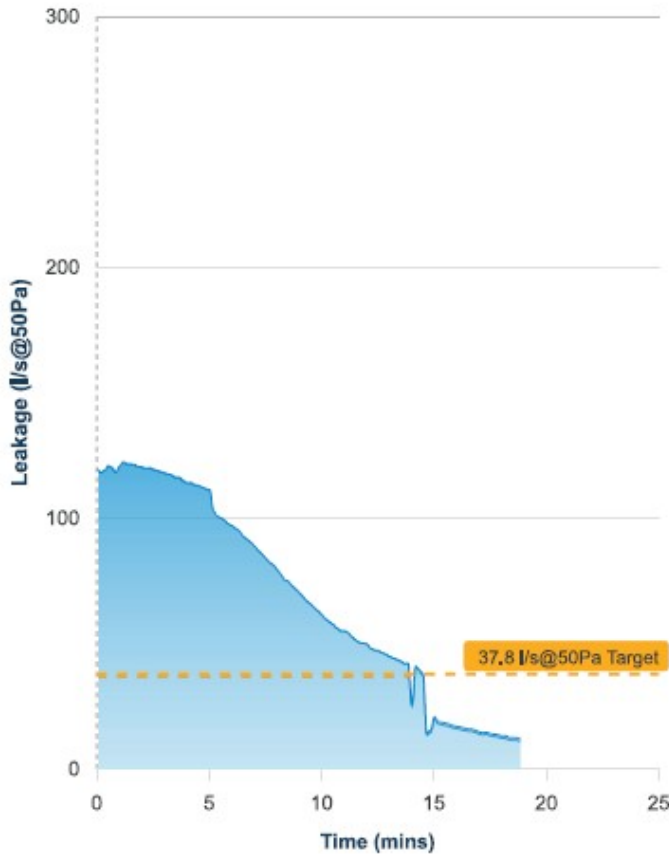

Note: Envelope leakage and air-change results are calculated at a STANDARD OPERATING PRESSURE of 50 Pa.

Envelope sealing performed by:

EnergyAir  
Puławska 17  
Warszawa, MZ 02-515  
Phone: 510 750 400

Aeroseal Case ID:  
Hardware: AeroBarrier Select

ACH@50Pa

3.91

ACH@50Pa

0.40

ACH@50Pa

Leakage equivalent to

202.8 cm<sup>2</sup>

20.6 cm<sup>2</sup>

● Before ● After

89.8%

Reduction in  
Envelope  
Leakage

00:18

hh:mm  
Seal Time

Scan for more details

Aeroseal  
aeroseal.com  
877-999-9999  
info@aeroseal.com

